

100
~

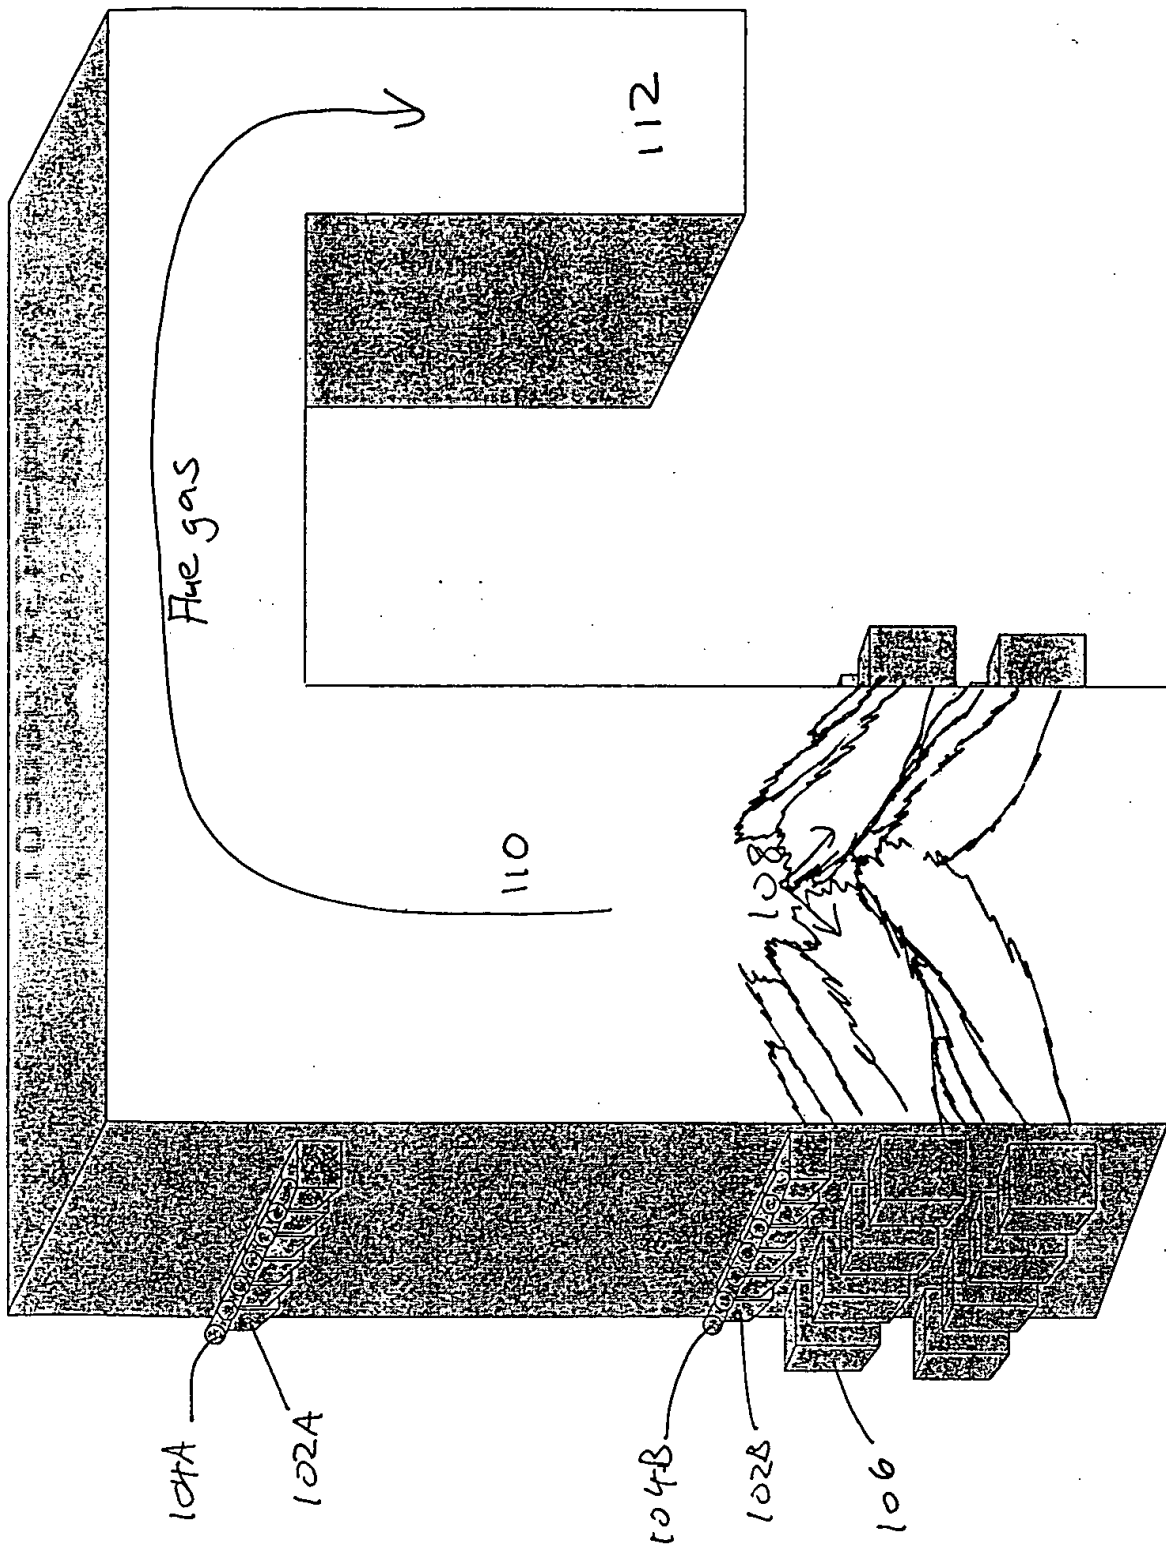


Fig. 1

200
~

204
/

202
/

212
/



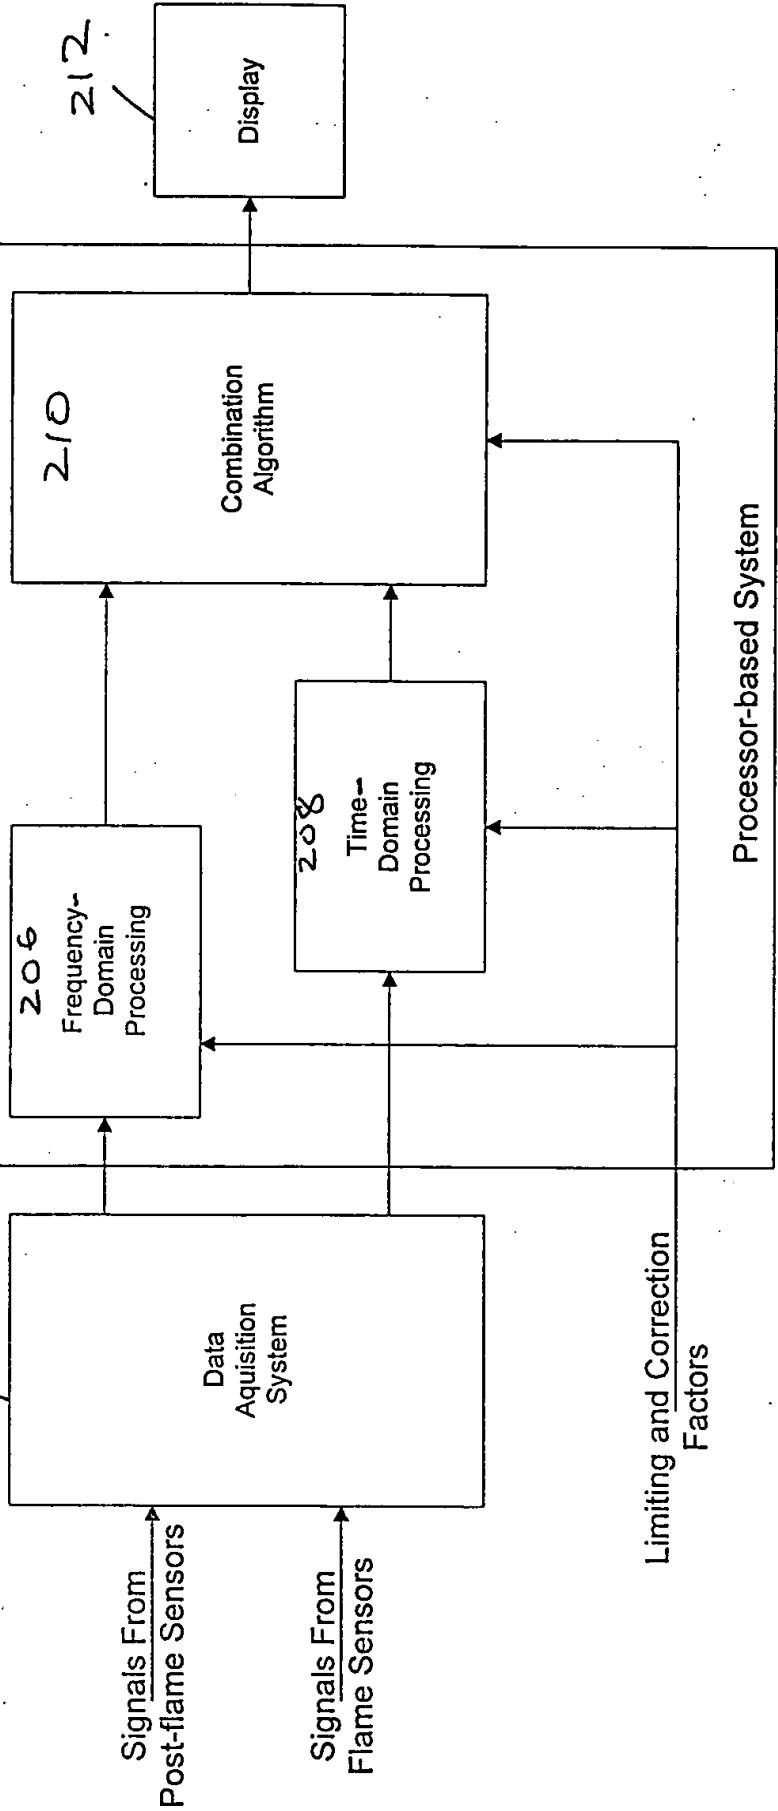


Fig. 2

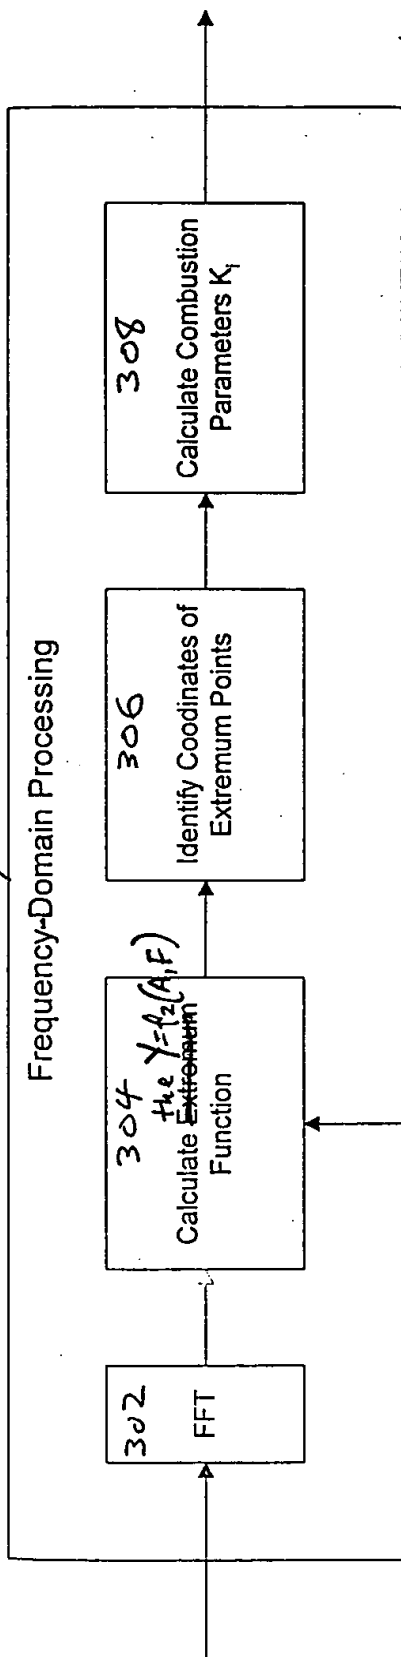



Limiting and Correction Factors

Fig. 3

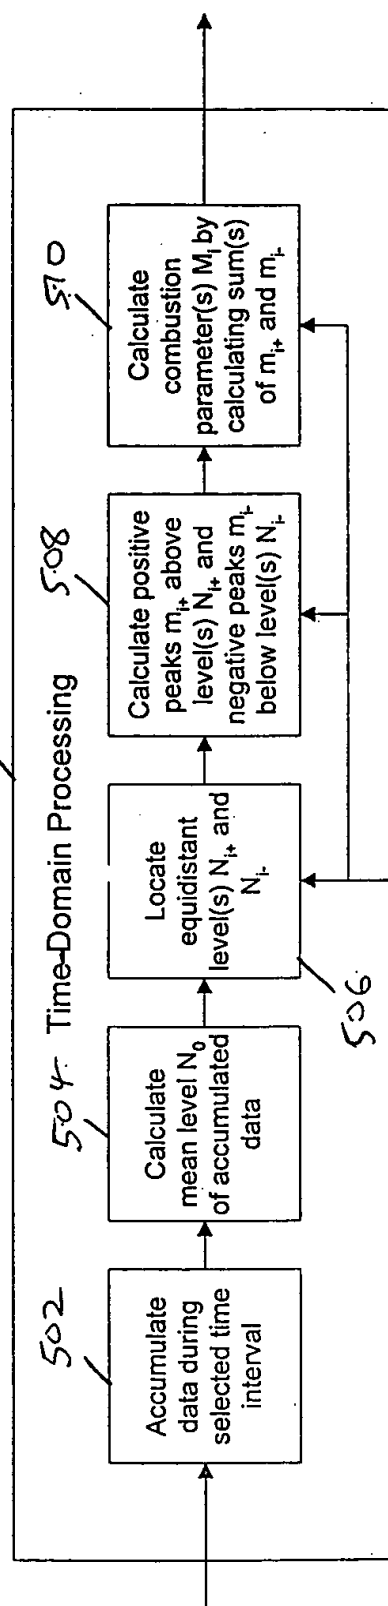

Limiting and Correction Factors

Fig. 5

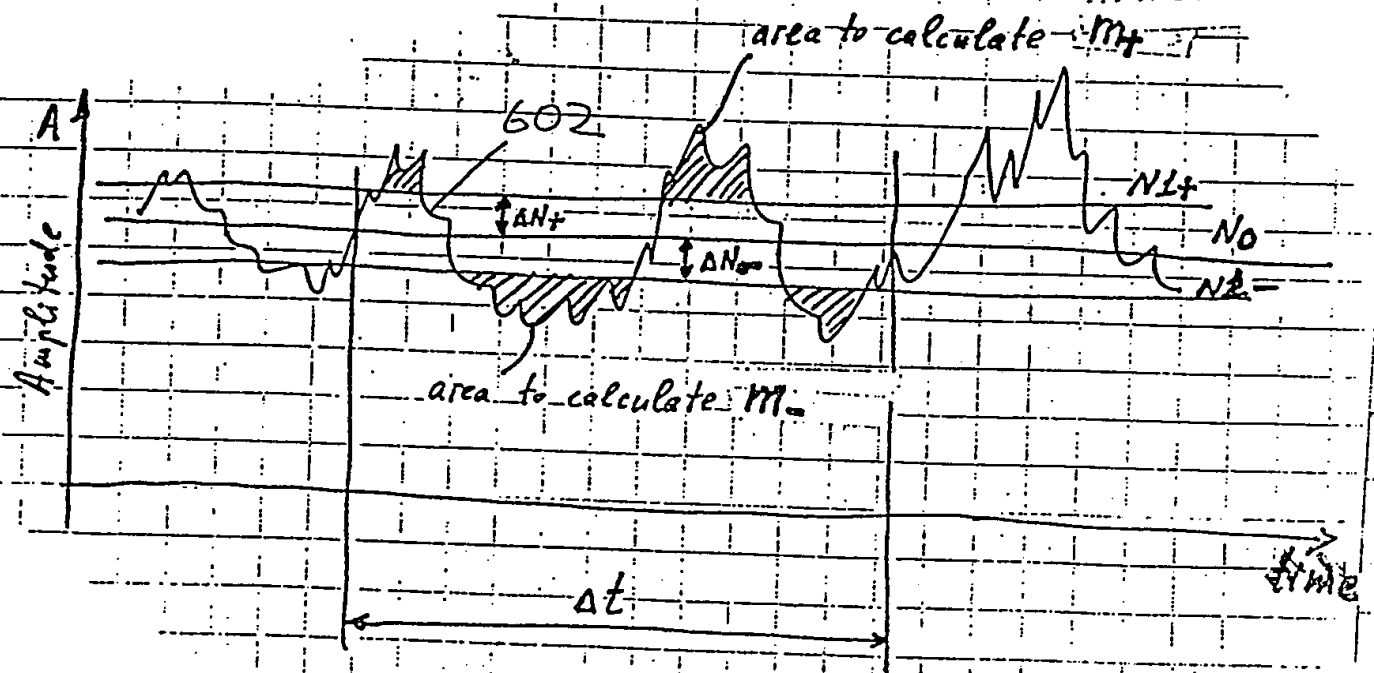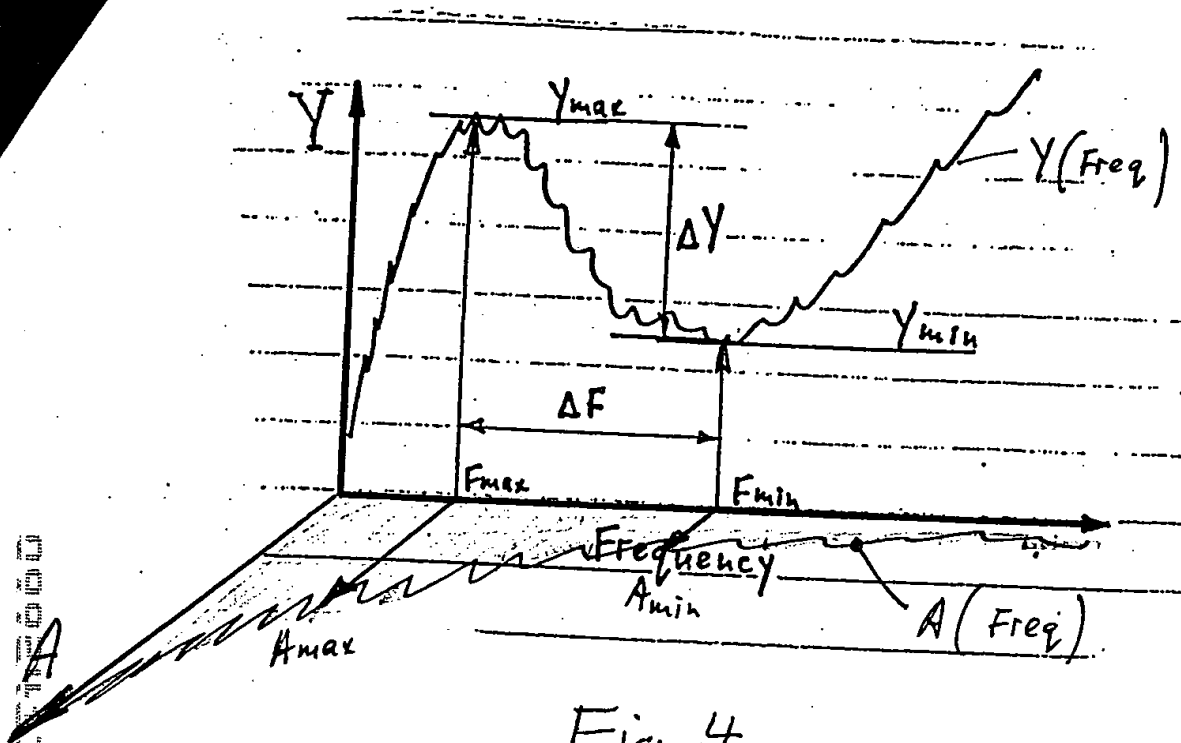

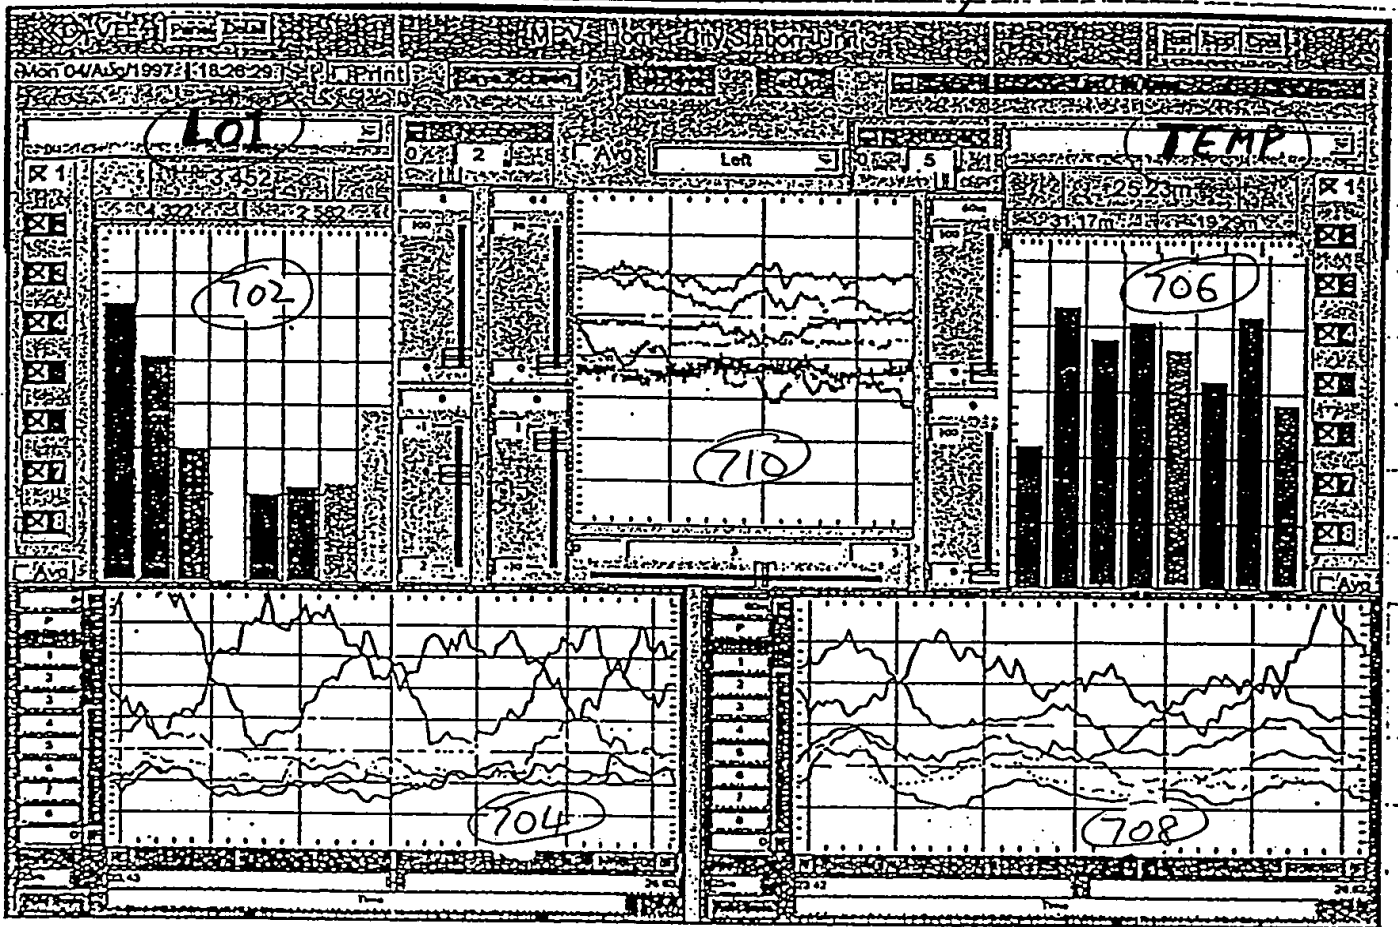


Fig. 7a

212

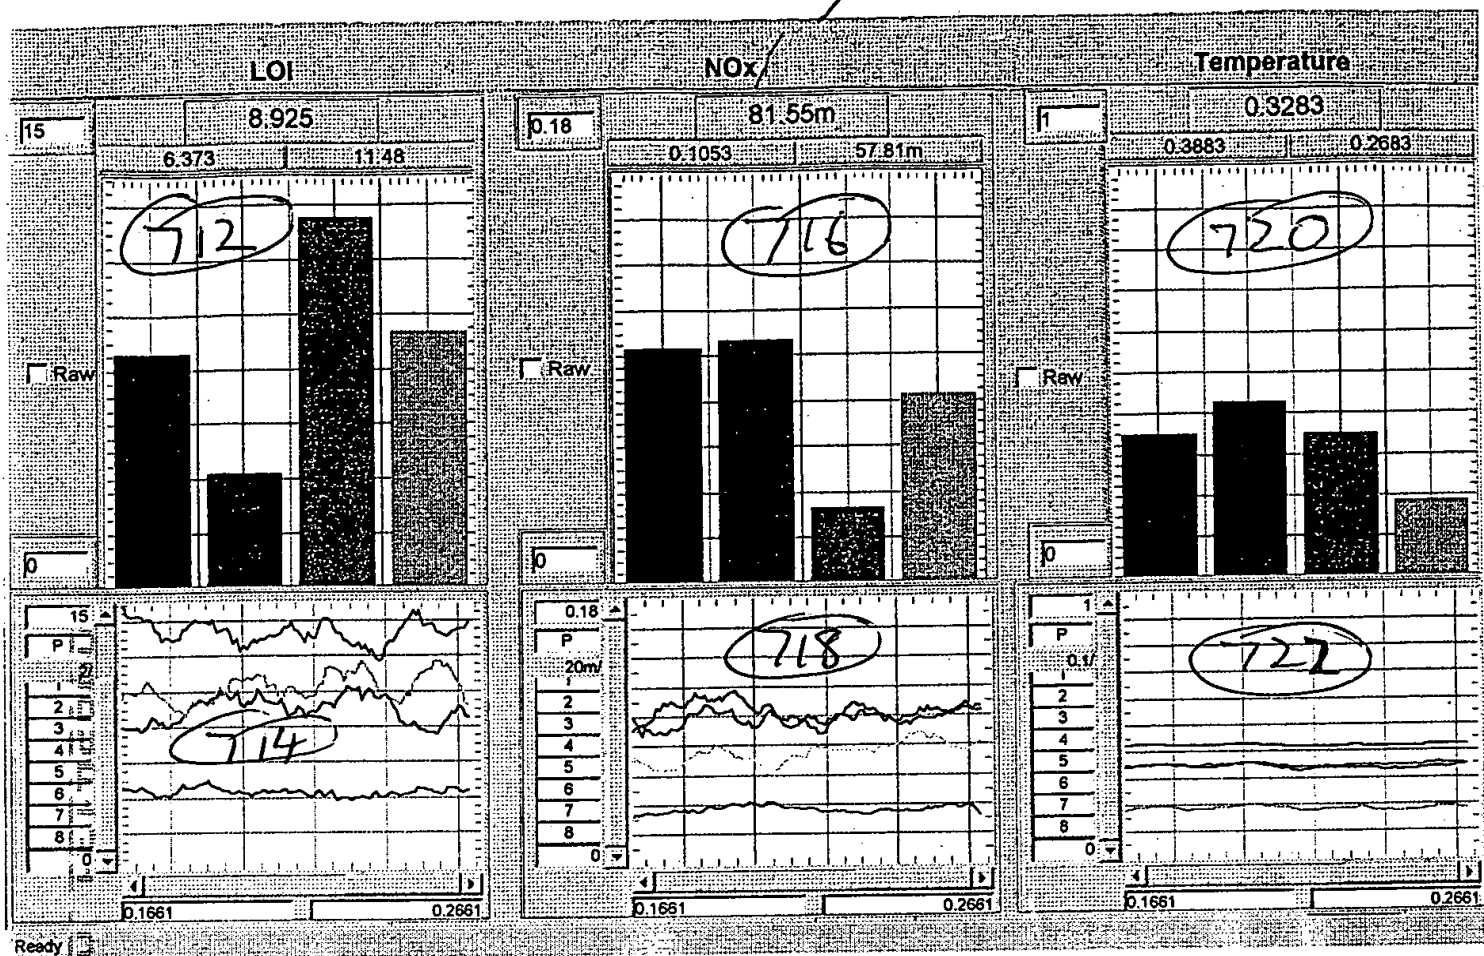


Fig. 7b

Boiler Balancing

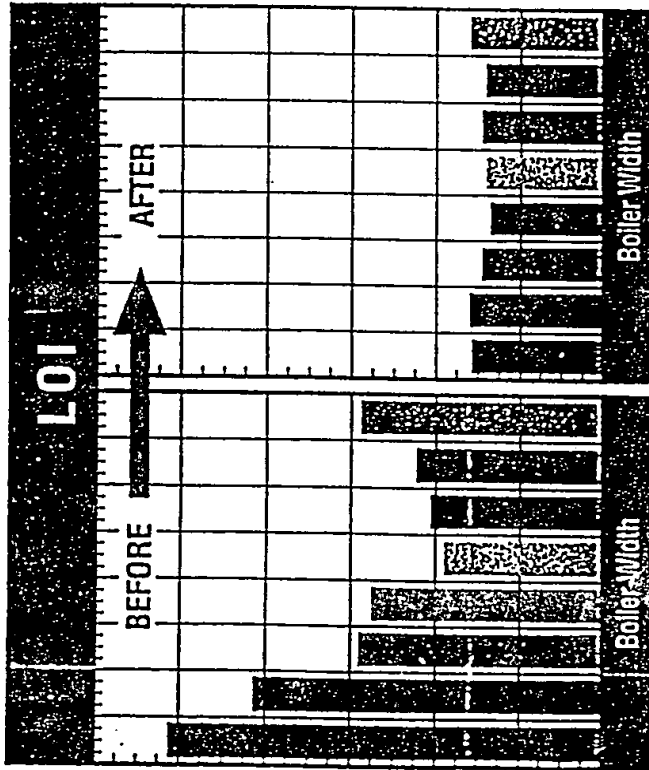


Fig. 8a.

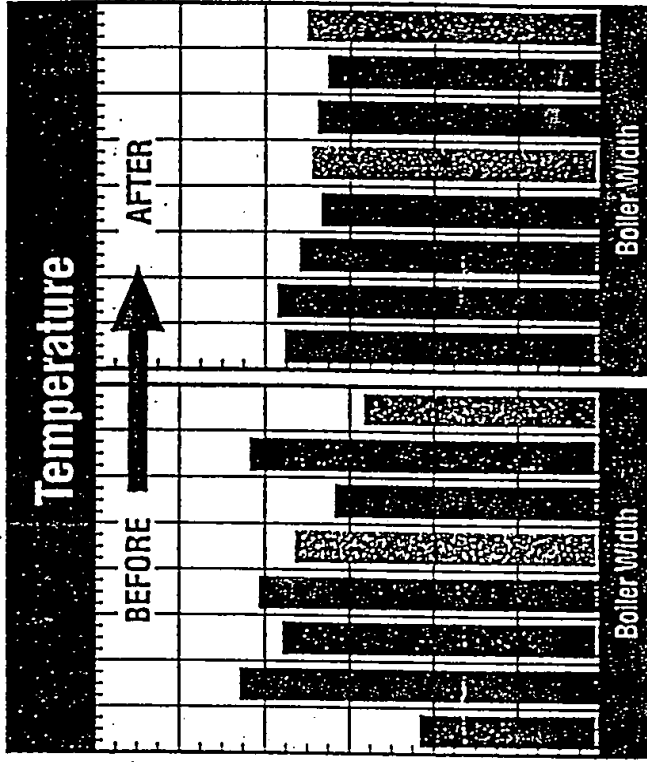


Fig. 8b.

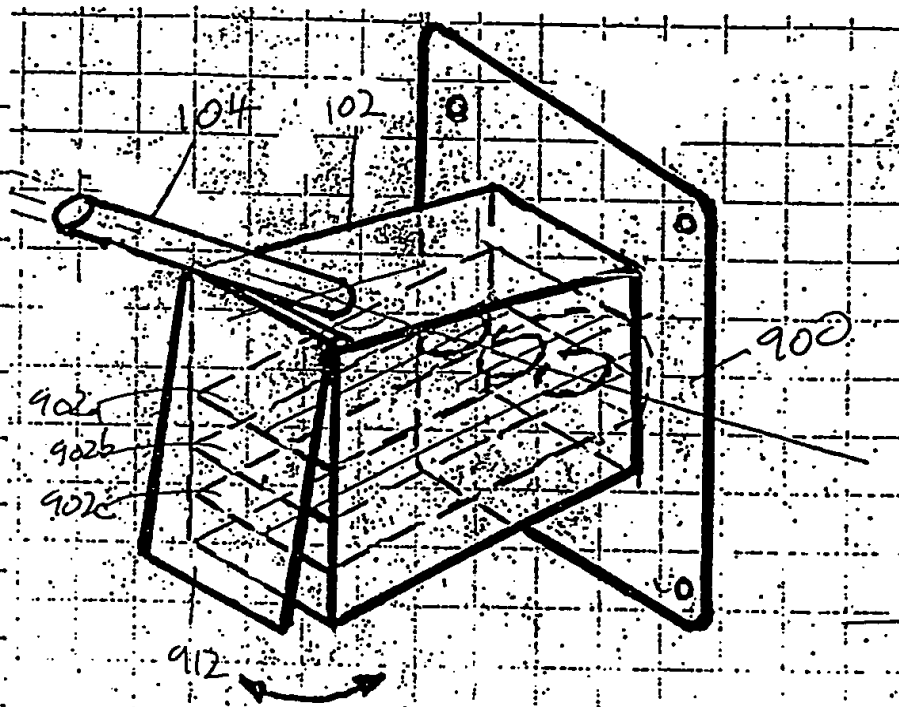


Fig. 9a

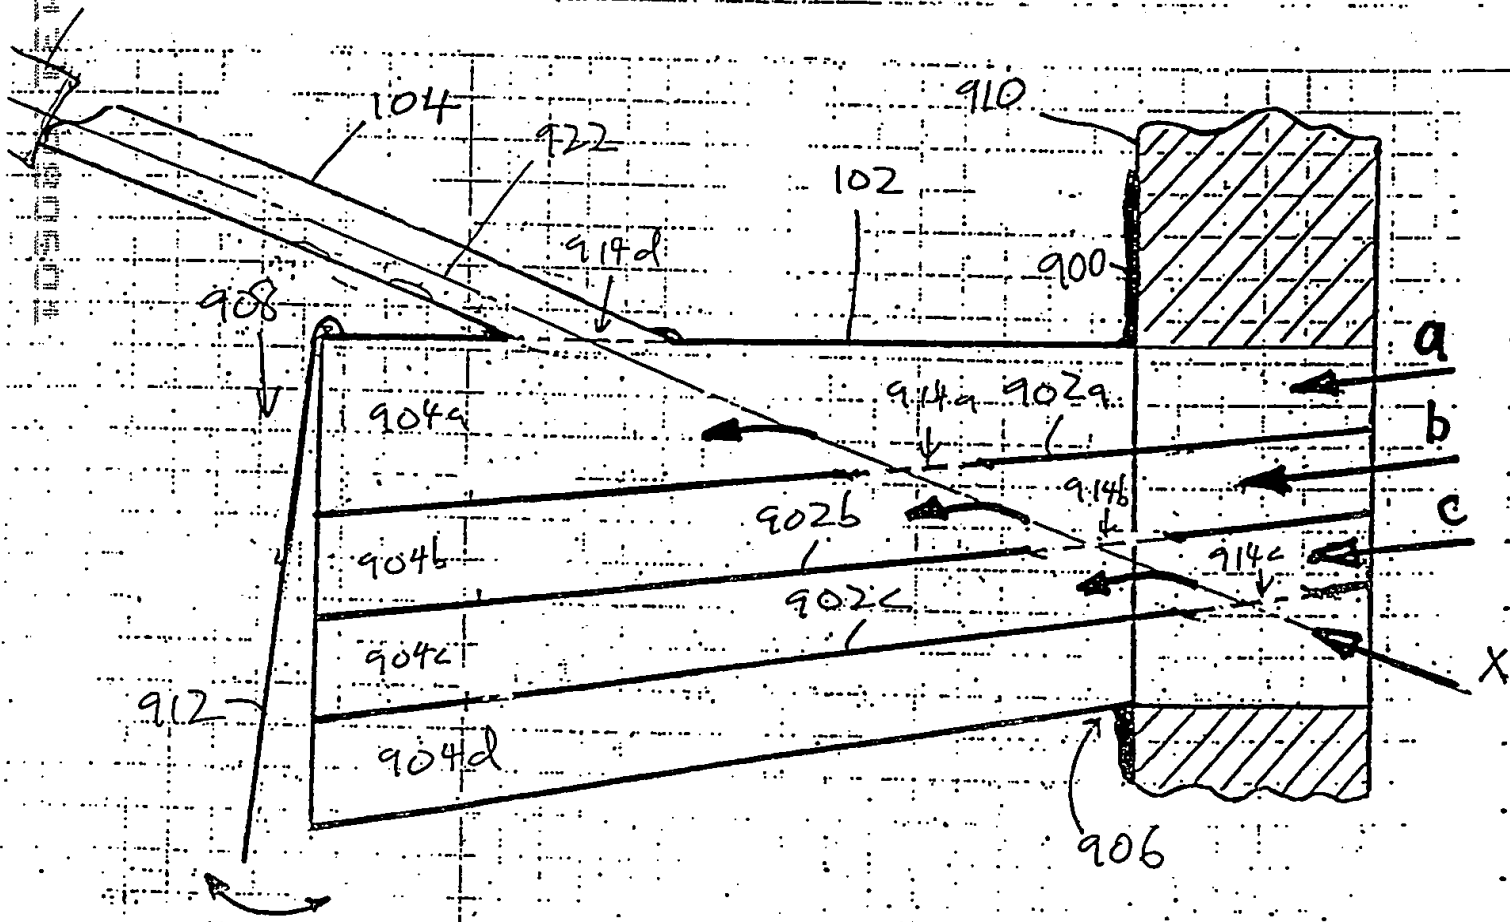


Fig. 9b